



# Argonne Scan anl3542Hv on 20020924 with CF ID = 14


**Module Average**

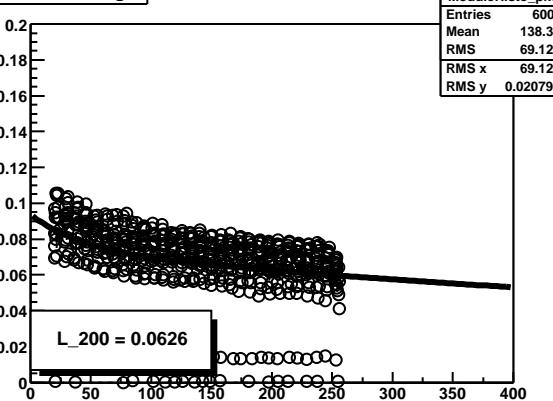


**L200 per strip**

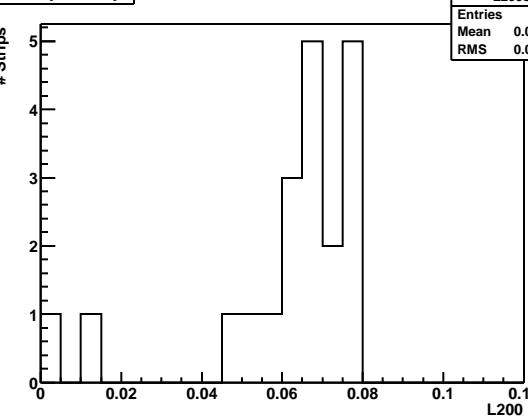


**L200 vs Strip**

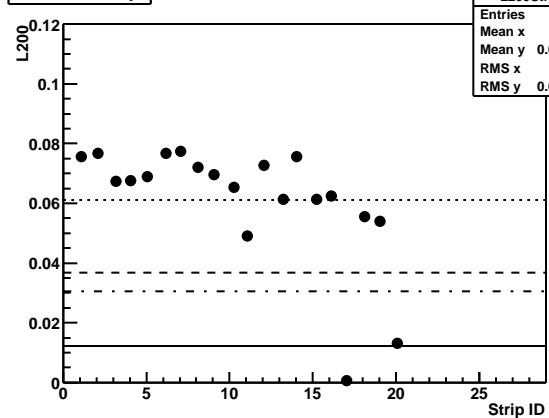


**Fiber Average**

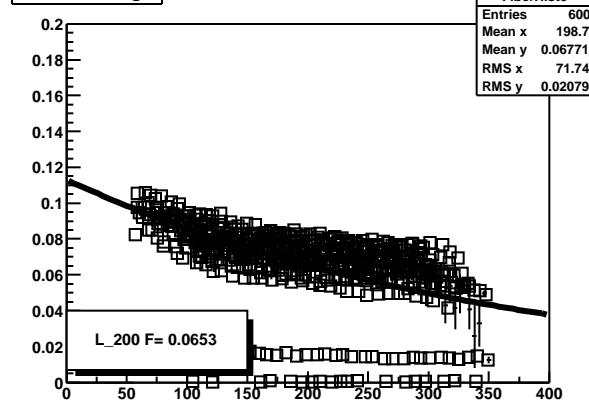


**L200 Fiber per strip**

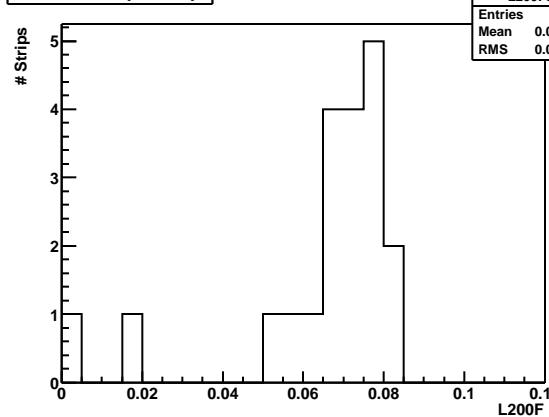


**L200 Fiber vs Strip**

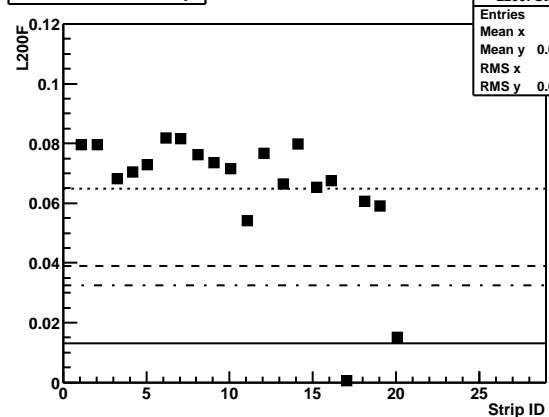


**20 pc Deviants**

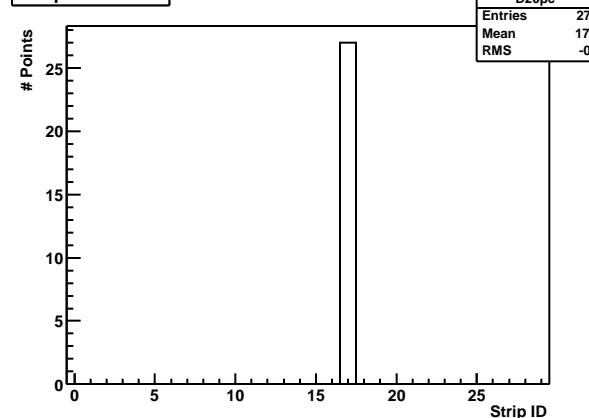

**30 pc Deviants**






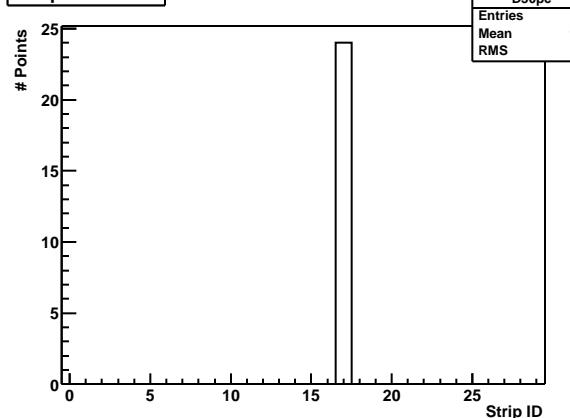


**Ratios**

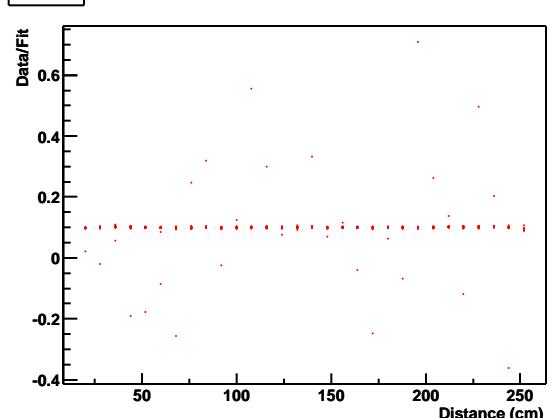







Thu Sep 26 10:46:38 2002

# Argonne Scan anl3542Hv on 20020924 with CF ID = 14

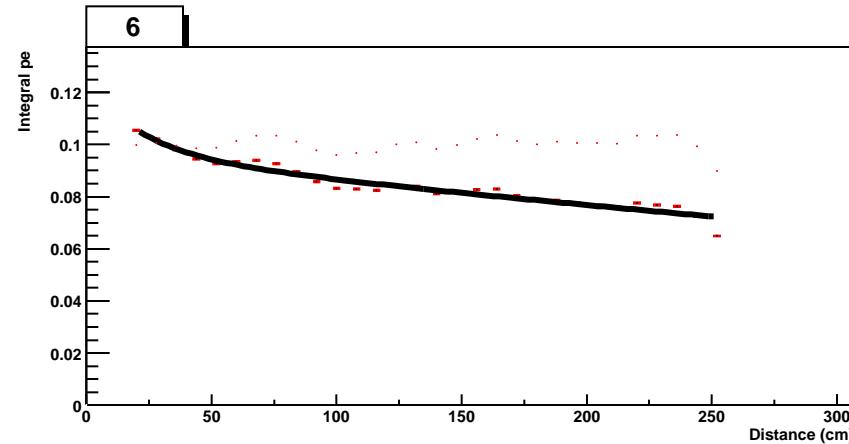
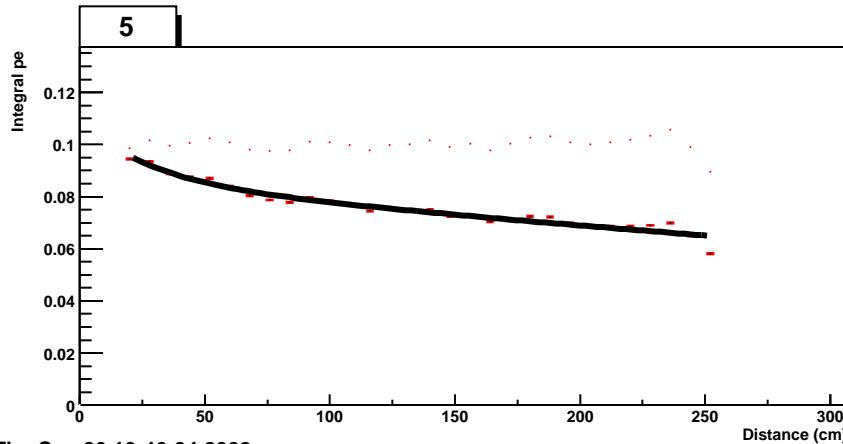
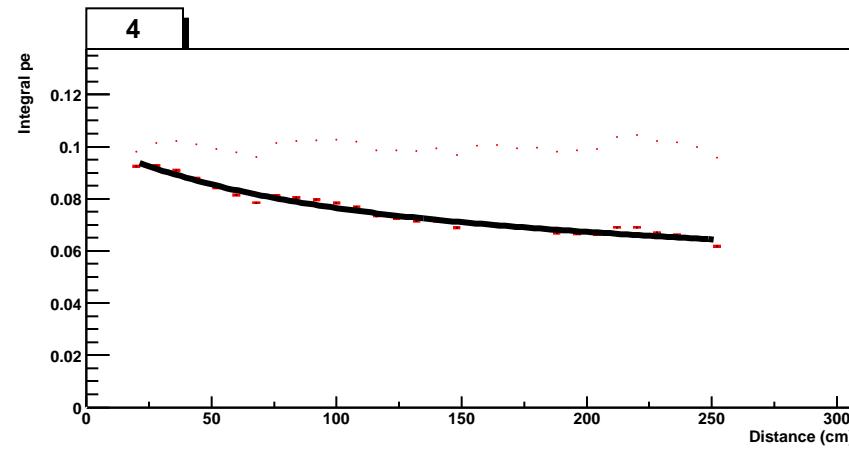
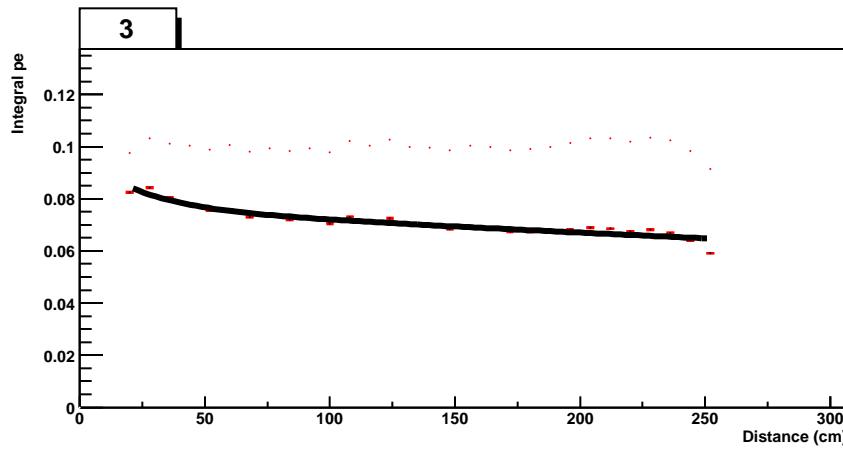
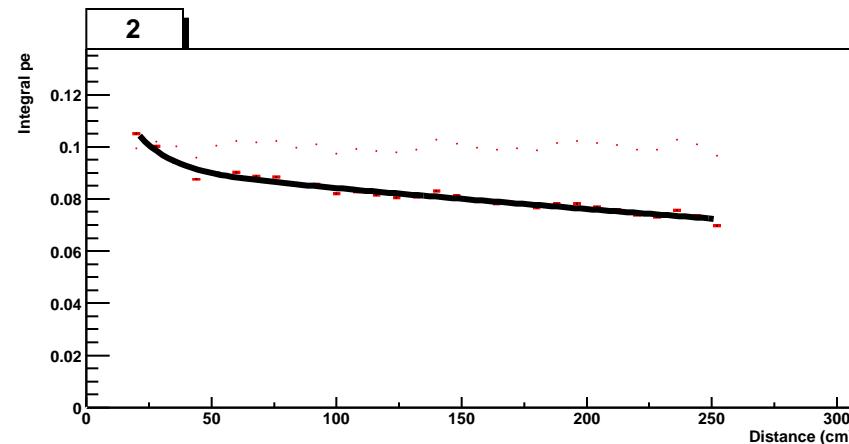
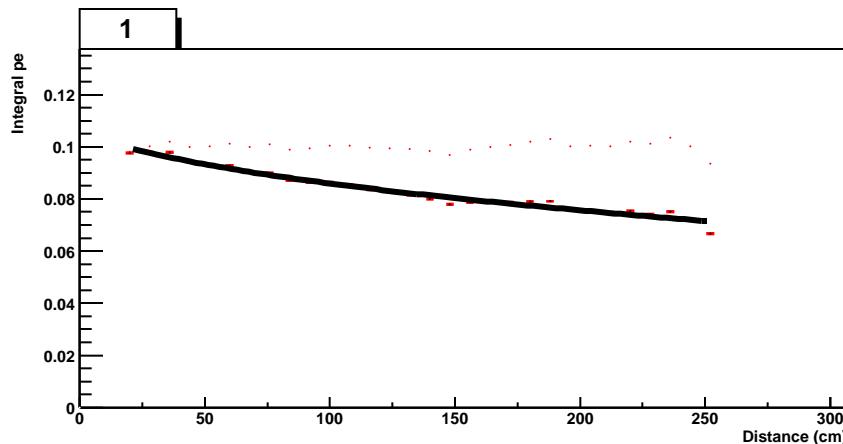


Thu Sep 26 10:46:34 2002





Argonne Scan anl3542Hv on 20020924 with CF ID = 14

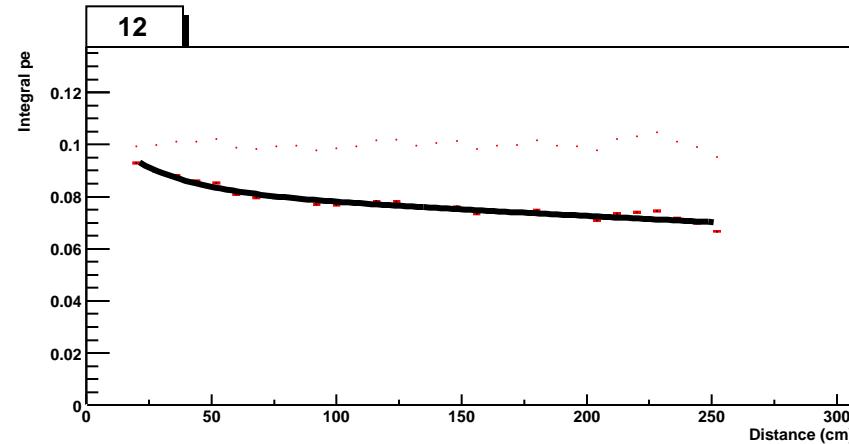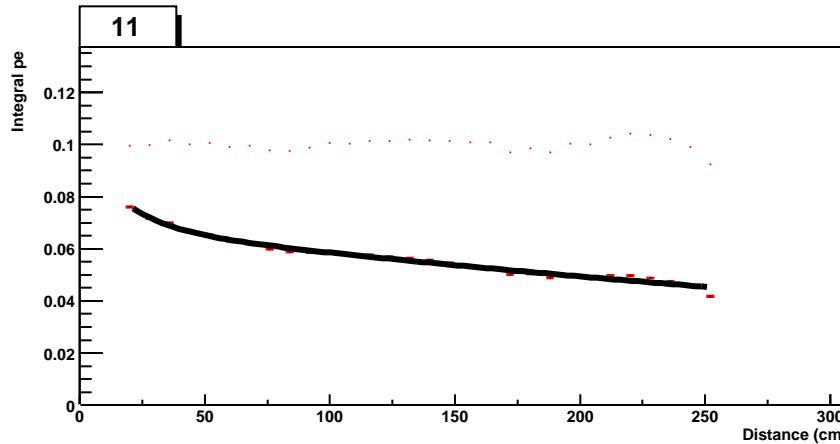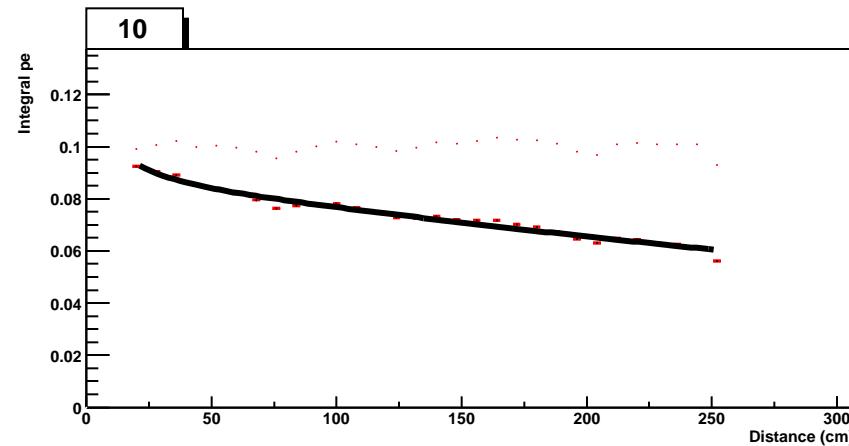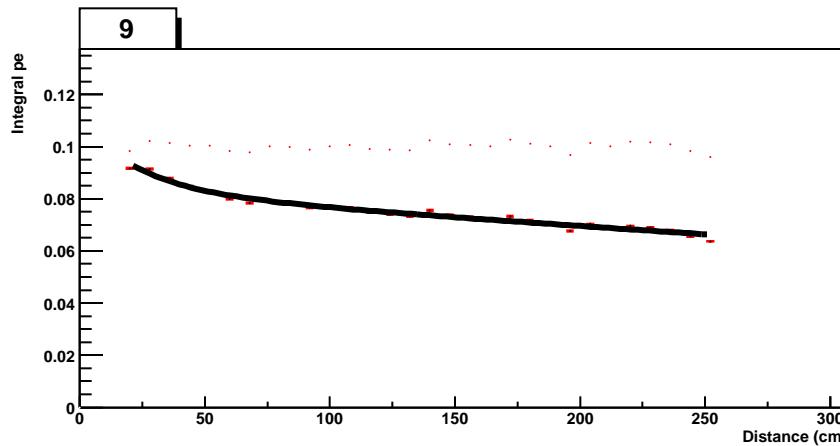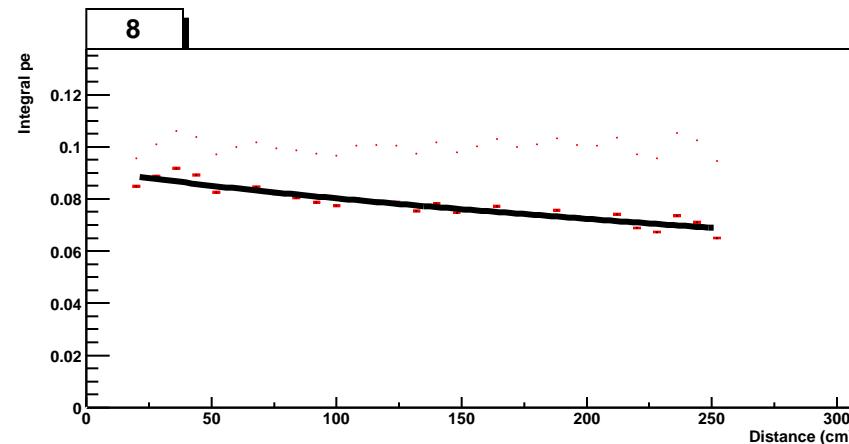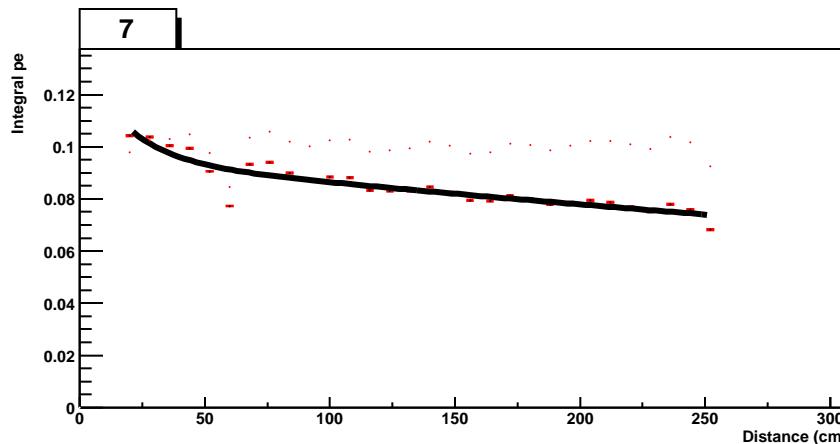

Argonne Scan anl3542Hv on 20020924 with CF ID = 14

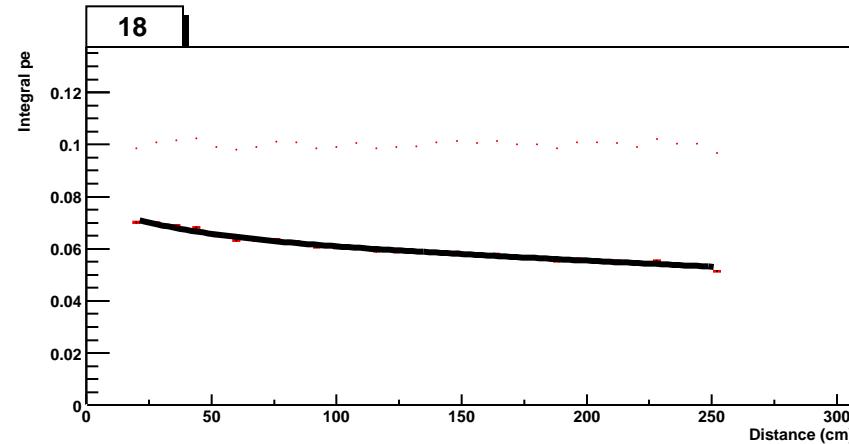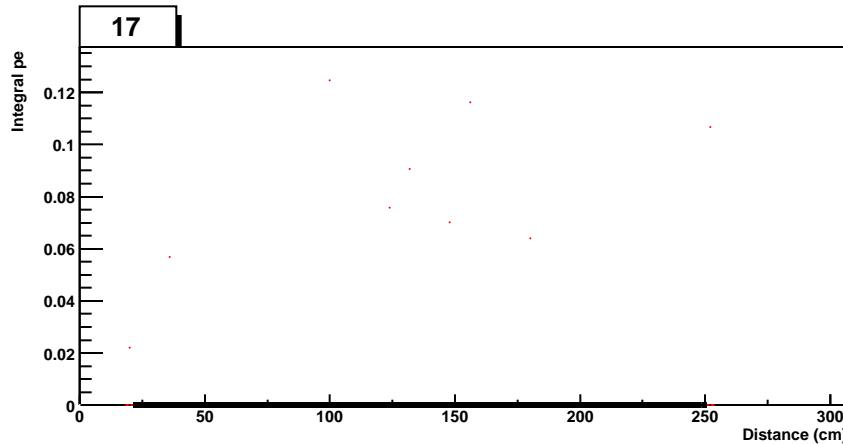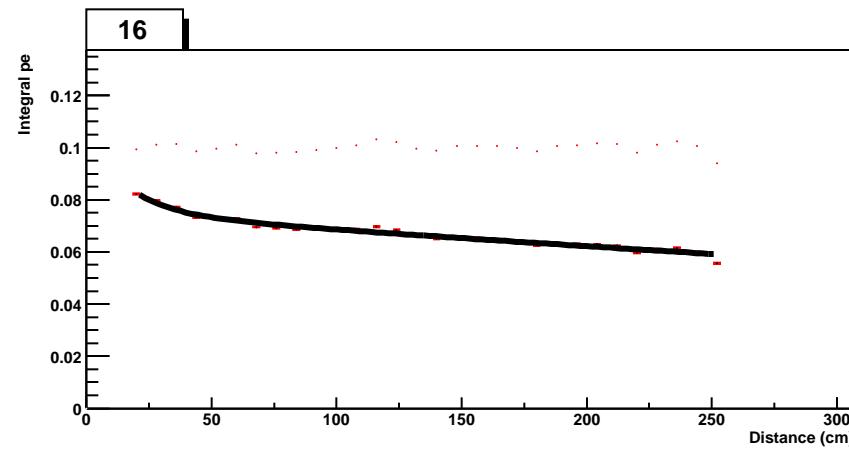
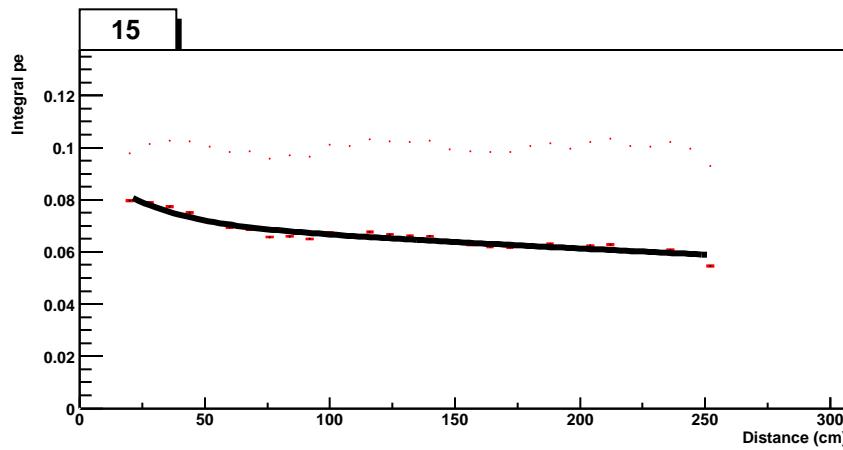
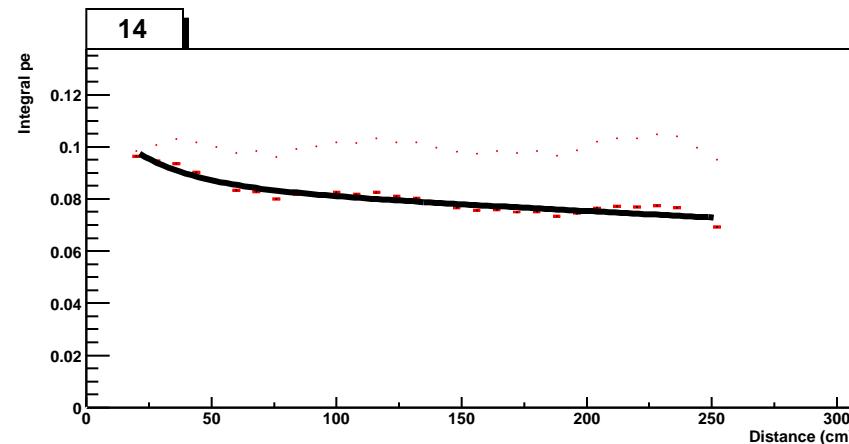
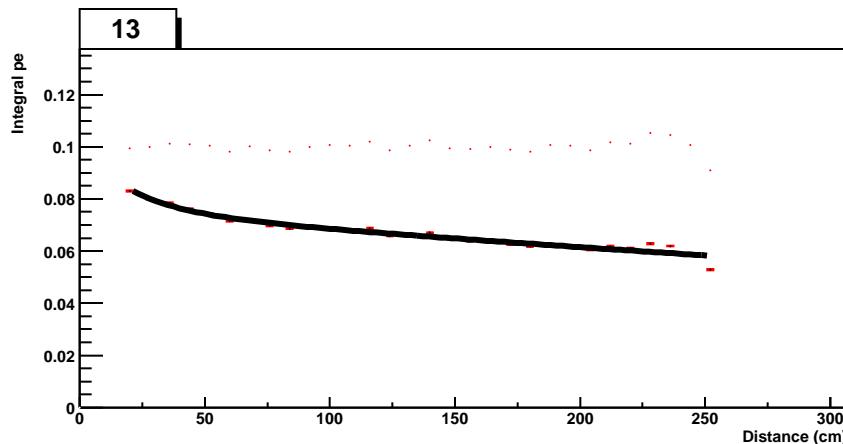


# Argonne Scan anl3542Hv on 20020924 with CF ID = 14

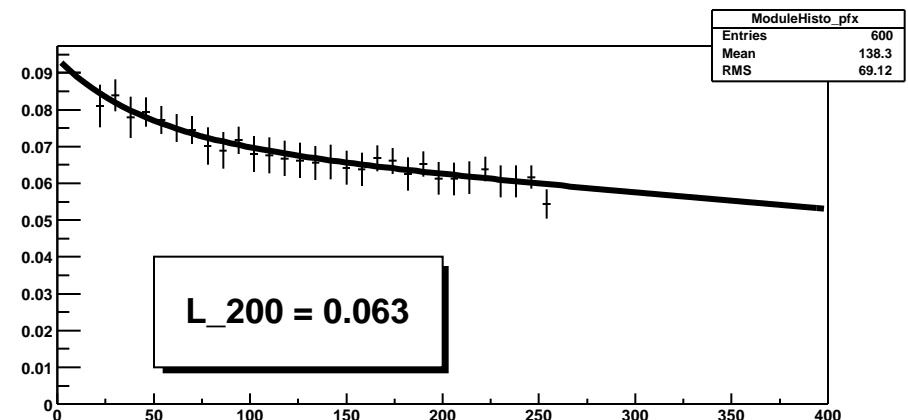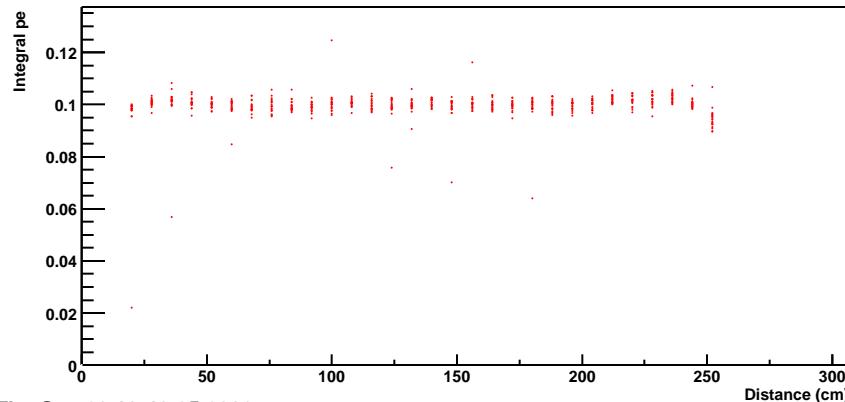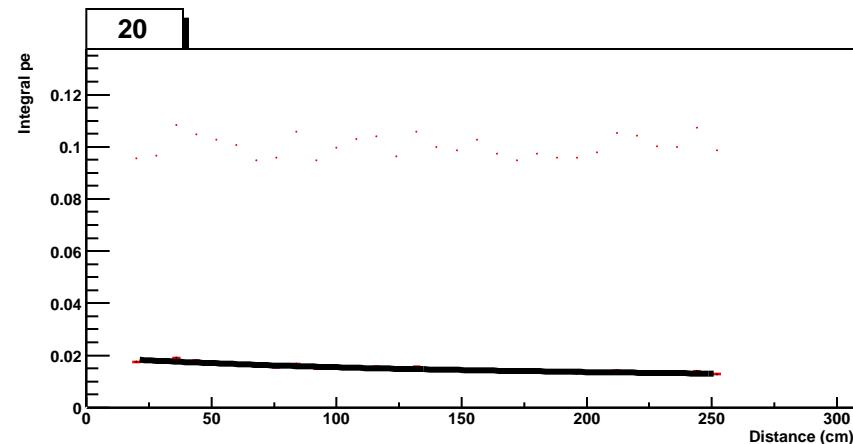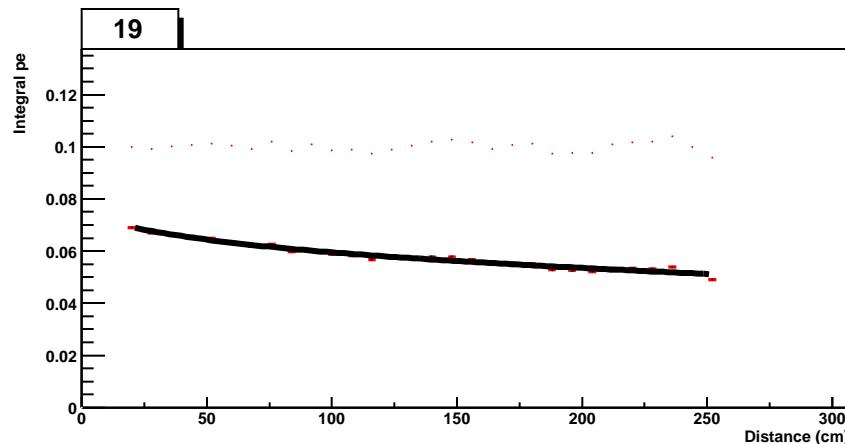

Thu Sep 26 10:46:35 2002

# Argonne LI Scan for anl3542Hv

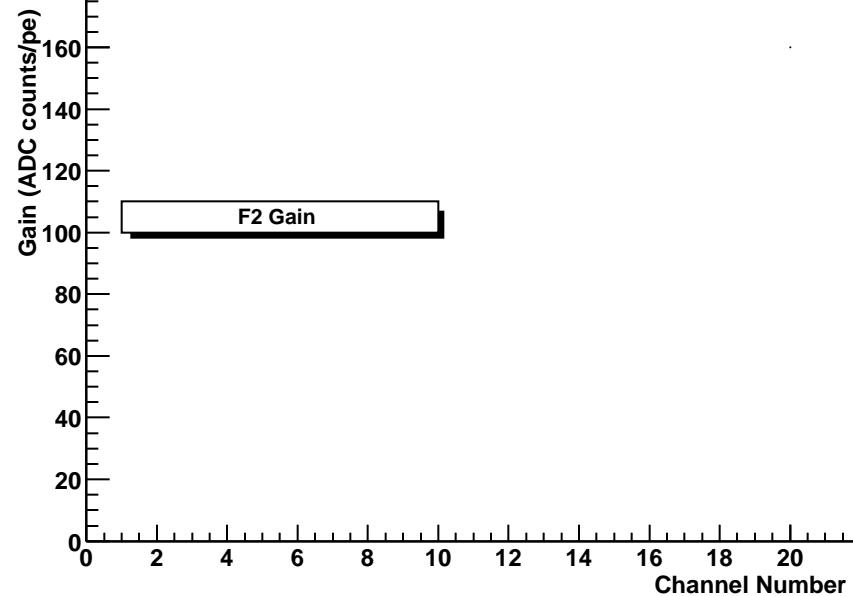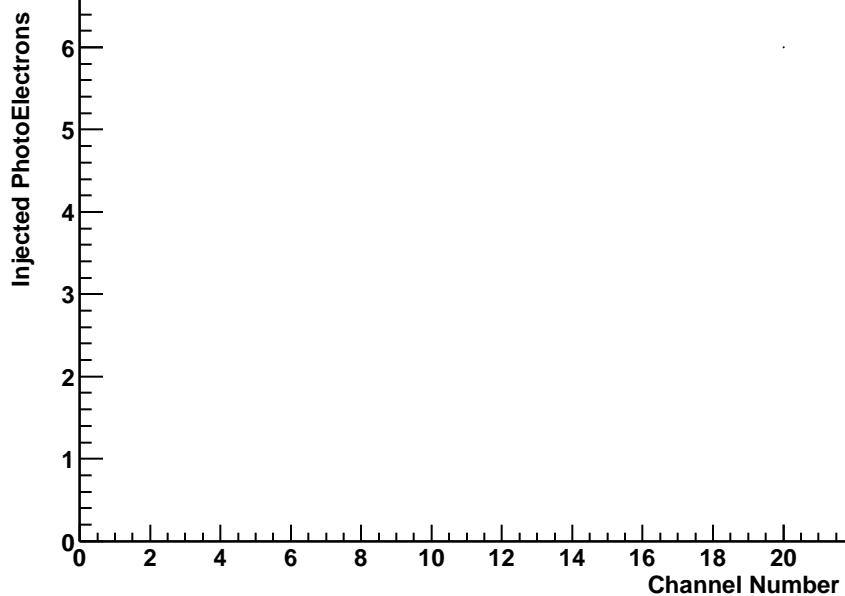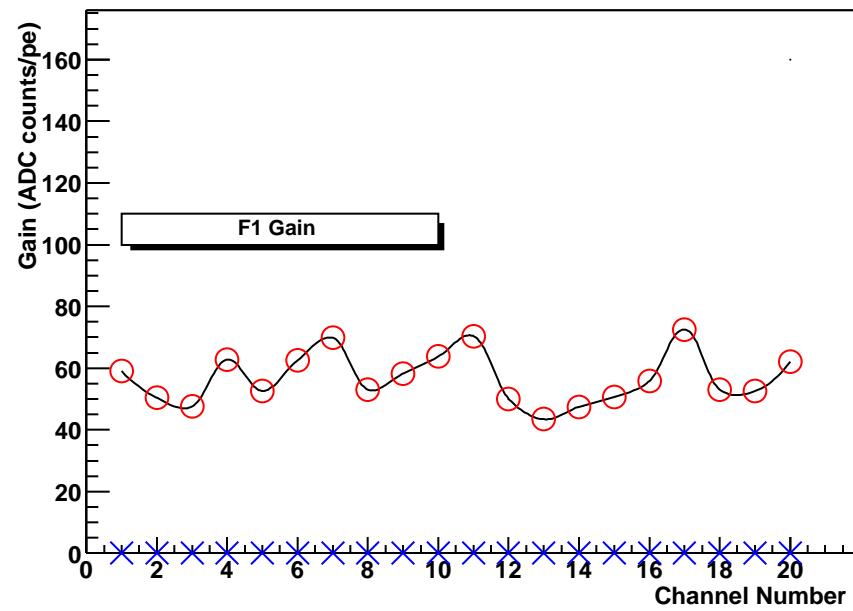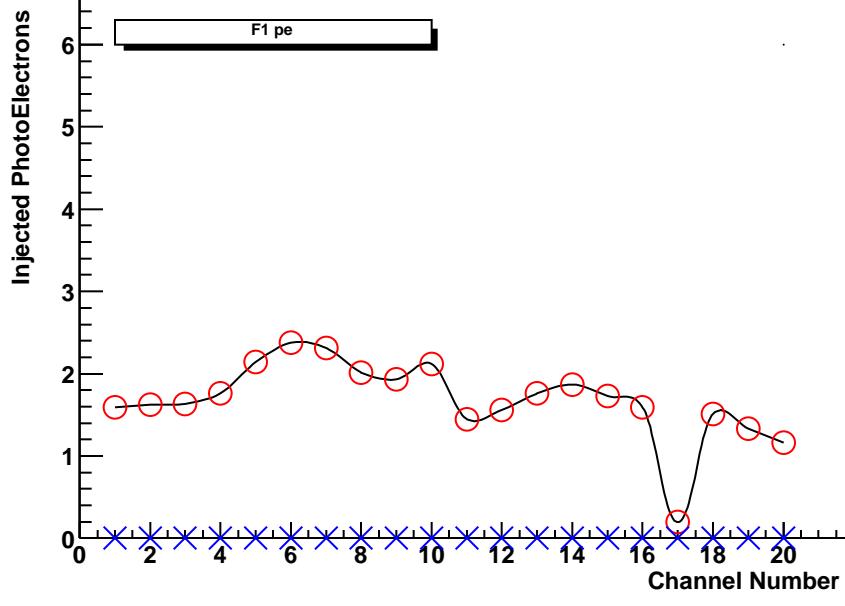

Thu Sep 26 10:45:54 2002